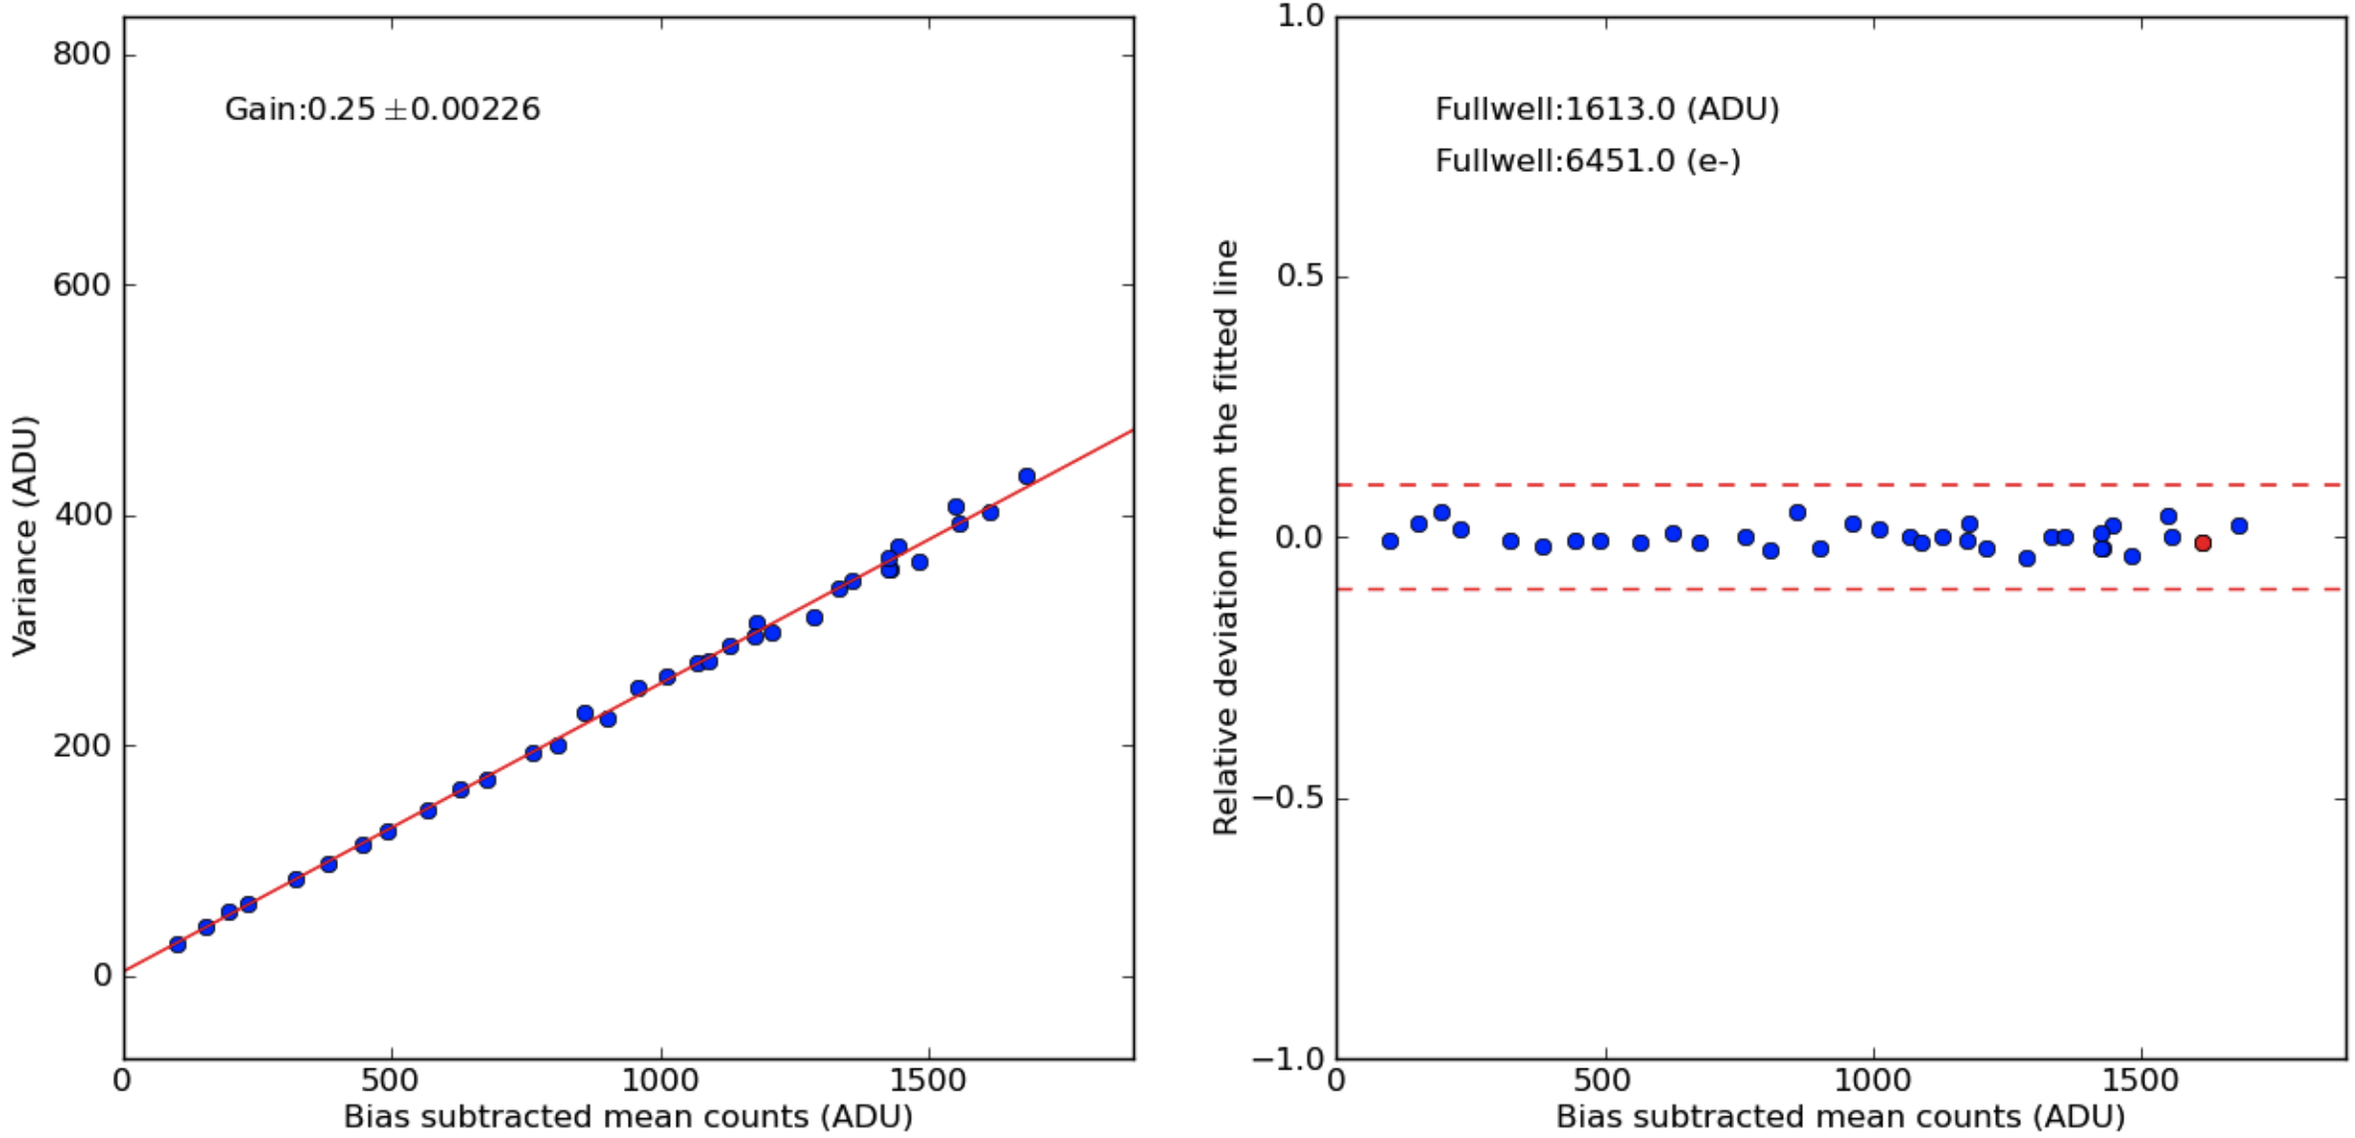
Gain:0.25 ±0.00226
Variance (ADU)
Bias subtracted mean counts (ADU)
Fullwell:1613.0 (ADU)
Fullwell:6451.0 (e-)
Relative deviation from the fitted line
Bias subtracted mean counts (ADU)